

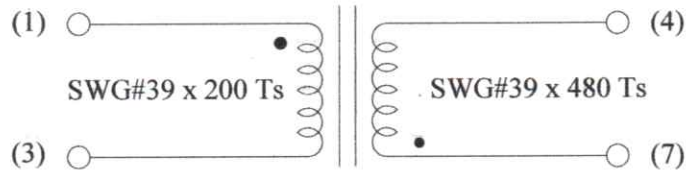
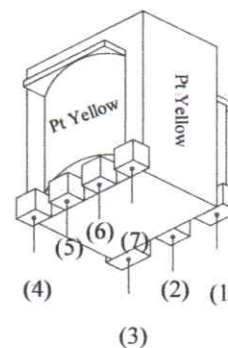
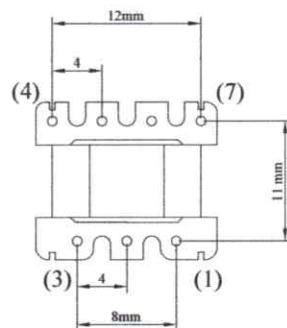


1. Schematic Diagram.

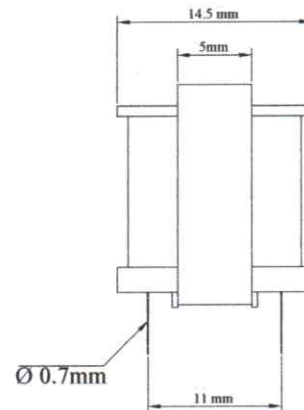

2. Configuration and Dimension.

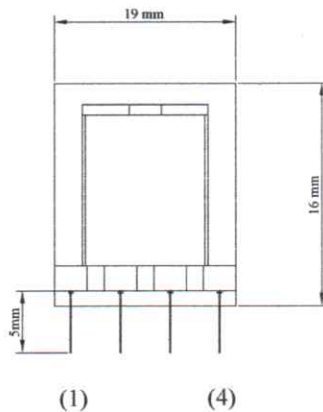

Material

Item	Material	Description
1	Bobbin	PHENOLIC EE-19 (7Pin)
2	Copper wire	2UEW
3	Insulation tape	0.025mm
4	Varnish	Hi-Term BC-359
5	Ferrite Core	EE-19
6	Solser	60/40 Sn/Pb

Electric Characteristics

Inductance and Resistance ($\pm 10\%$).

1-3	10.80 mH , 7.30 Ω
7-4	62.90 mH , 22.70 Ω

High Potential Test.

Apply AC 1.5KV 1mA, Coil to Core and Coil to Coil, for 1Munite. and Should not be any abnormality.

EAST ELECTRIC ACCESSORY CO.,LTD.

220/2 Saiwadcok Road Tambon Bangprok Amphur Muang Pathoomthanee 12000

Tel : +662 (02) 5811621-4 Fax : +662 (02) 5811620

www.eea - trafo.com E-mail : eea-trafo@hotmail.com

(052000085)

Customer : ELECTRONICS SOURCE	EEA Part No. : F1905471	Prepared by :
Customer Approved by :	Model : 11505	Approved by : 2/28/14
Position :	Revision : 1	Date : April 23 , 2014